

NOTES:

NO OTHER CONDUCTORS SHALL BE RUN IN THE SAME CONDUIT WITH ELECTRICAL SERVICE CABLE.

THIS STANDARD IS APPLICABLE FOR ALL ELECTRICAL SERVICES OTHER THAN 480Y/277.

WHEN 200 AMP OR GREATER SERVICE IS REQUIRED, SERVICE SHALL ENTER METER BASE ACCORDING TO UTILITY COMPANY STANDARD.

LOCAL POWER UTILITY COMPANY WILL INSTALL SERVICE POWER UTILITY CABLES FROM THEIR POWER SOURCE TO THE JUNCTION BOX AND MAKE REQUIRED SPLICES TO THE SERVICE CABLES COILED IN THE JUNCTION BOX.

GROUNDING BUSHINGS SHALL BE INSTALLED ON EACH END OF METAL CONDUITS.


EMPTY CONDUITS SHALL BE PLUGGED TO PREVENT MOISTURE AND RODENT ENTRY.

BELL ENDS SHALL BE INSTALLED ON EACH END OF PVC CONDUITS.

OPEN ENDS OF CONDUITS WITH CONDUCTORS INSTALLED SHALL BE SEALED WITH AN APPROVED SOFT, PLIABLE, AND EASILY REMOVABLE WATERPROOF SEALANT. THE SEALANT SHALL NOT HAVE A DELETERIOUS EFFECT ON CABLE COVERINGS.

EACH ELECTRICAL SERVICE FEEDER SHALL BE SEPARATED AND TAGGED IN ACCESSIBLE LOCATIONS INSIDE THE POLE TO PERMANENTLY IDENTIFY LIGHTING AND SIGNAL POWER CABLES.

POLE HEIGHT AND SIZE WILL BE AS SPECIFIED ON THE PLANS. REFER TO STANDARD MP-2 FOR GROUNDING LUG DETAIL.

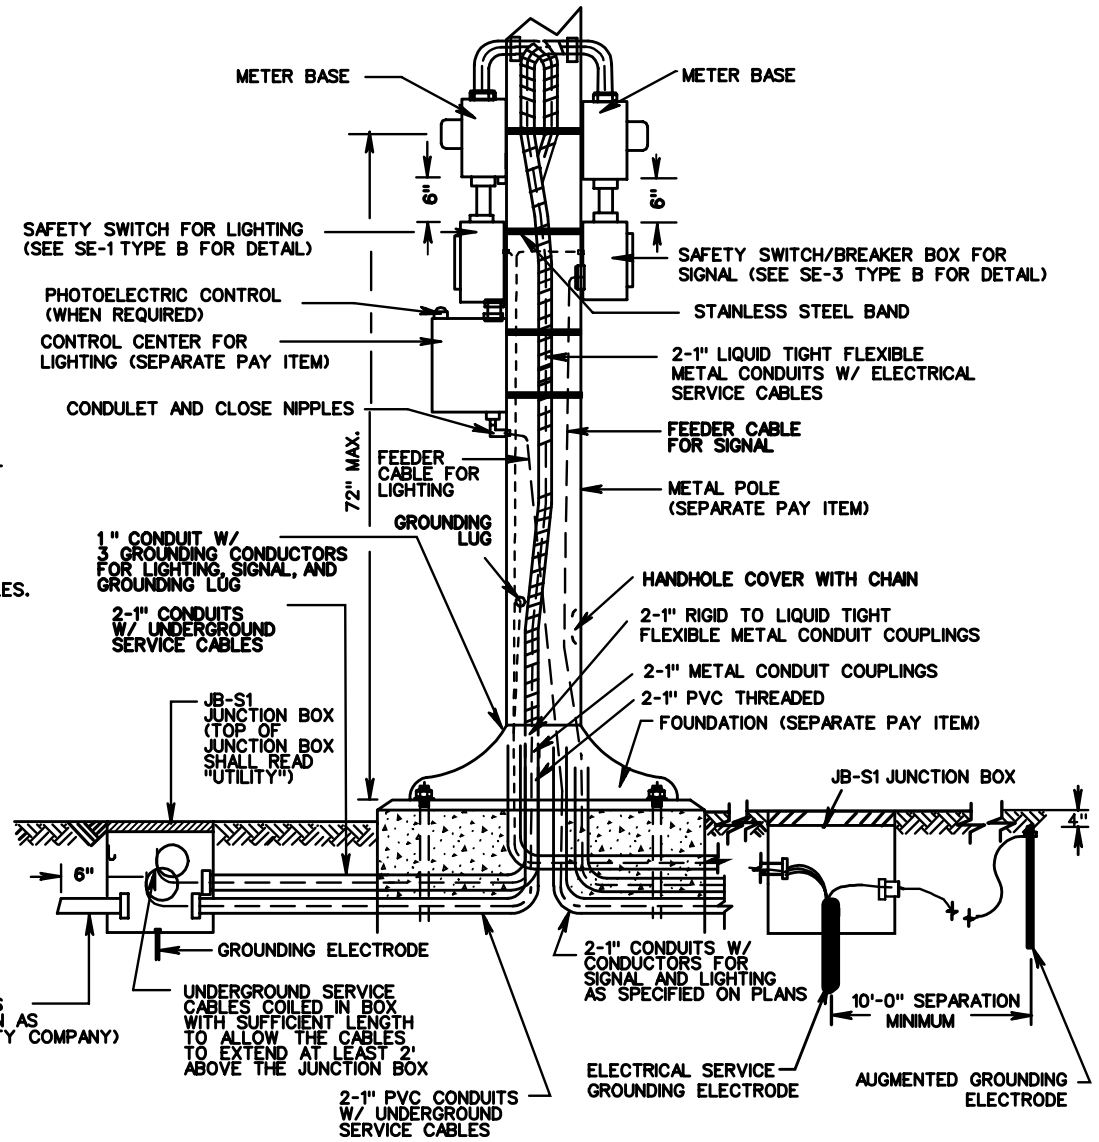

**TYPE B
(UNDERGROUND SERVICE)
METAL POLE**

SPECIFICATION REFERENCE
700

**ELECTRICAL SERVICE
INSTALLATION DETAILS**
VIRGINIA DEPARTMENT OF TRANSPORTATION

VDOT	
ROAD AND BRIDGE STANDARDS	
REVISION DATE	SHEET 2 OF 2
	1313.21