




- 1. APRON IS TO BE CONSTRUCTED TO A DEPTH OF 1'-0" ON BACK SLOPE SIDE OF INLET (DI-7), ON ROADWAY SIDE, THE DEPTH IS TO BE 1'-0" OR TO THE SHOULDER ELEVATION, WHICHEVER IS LESSER.
- ALTERNATE METHODS OF ANCHORING ANGLE IRON WILL BE ACCEPTABLE IF APPROVED BY THE ENGINEER.
- 3. COLLAR AND GRATE ARE TO BE GALVANIZED IN ACCORDANCE WITH THE SPECIFICATIONS.
- 4. OUTSIDE DIMENSIONS OF GRATE ARE TO BE 3'-4" X 2'-11 3/4".
- 5. ALL CONCRETE IS TO BE CLASS A3.
- 6. NORMAL DITCH IS TO BE TRANSITIONED TO TIE SMOOTHLY INTO GUTTER. DITCH GRADE IS TO BE ADJUSTED AS NECESSARY TO MEET GRADE
- 7. QUANTITIES SHOWN ARE BASED ON DEPTH H =5'-0".
- 8. THE AMOUNT OF CONCRETE DISPLACED BY PIPES MUST BE DEDUCTED TO OBTAIN TRUE QUANTITIES. FOR EACH FOOT OF DIFFERENCE IN DEPTH H ADD OR SUBTRACT INCREMENT AS SHOWN.
- 9. SEE STANDARD DI-7, DI-7A AND DI-7B FOR DETAILS AND DIMENSIONS NOT SHOWN HEREON.
- 10. GRATE BARS ARE TO BE INSTALLED SO THEY WILL BE ALIGNED PARALLEL TO THE DITCH FLOW.

| APPROXIMATE QUANTITIES | |
|------------------------|----------------------|
| CLASS A3 CONCRETE | REINFORCING STEEL |
| CU. YDS. | LBS. |
| 4.091 | 60 |

INCREMENT PER FOOT OF DEPTH (H) = 0.362 CU. YDS. CONCRETE TO BE ADDED WHEN DOUBLE GUTTER IS REQ'D.=1.112 CU. YDS.

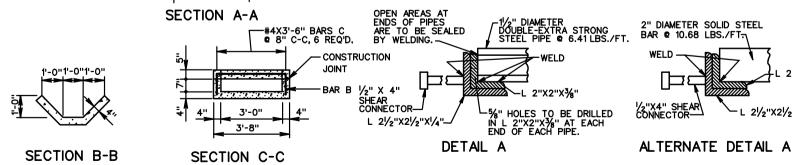

SHEET 3 OF 3

- L 21/2"X21/2"X1/4"

2"X2"X%

SPECIFICATION REFERENCE

502

STANDARD PG-4

B≪

B≪

#4X5'-4" BARS B @ 8" C-C, 5 REQ'D:

#4X1'-0" BARS D @ 8" C-C, 6 REQ'D,-

PAY LINE FOR INLET

PAY LINE FOR INLET

-5"

(TYP.)

3'-0"

4'-4"

12", 12"

-SEE DETIAIL

#6X4'-0" BAR A € 4" C-C 4 REQ'D.

DITCH SLOPE

3" DIAMETER

WEEP HOLE

STANDARD DI-7, 7A OR 7B WITH FLUME CONNECTION 12" TO 36" PIPE

VIRGINIA DEPARTMENT OF TRANSPORTATION

104.24