


Notes:

No other conductors shall be run in the same conduit with electrical service cable.

For alternate method of service cable and grounding conductor entering breaker box, see standard SE-5

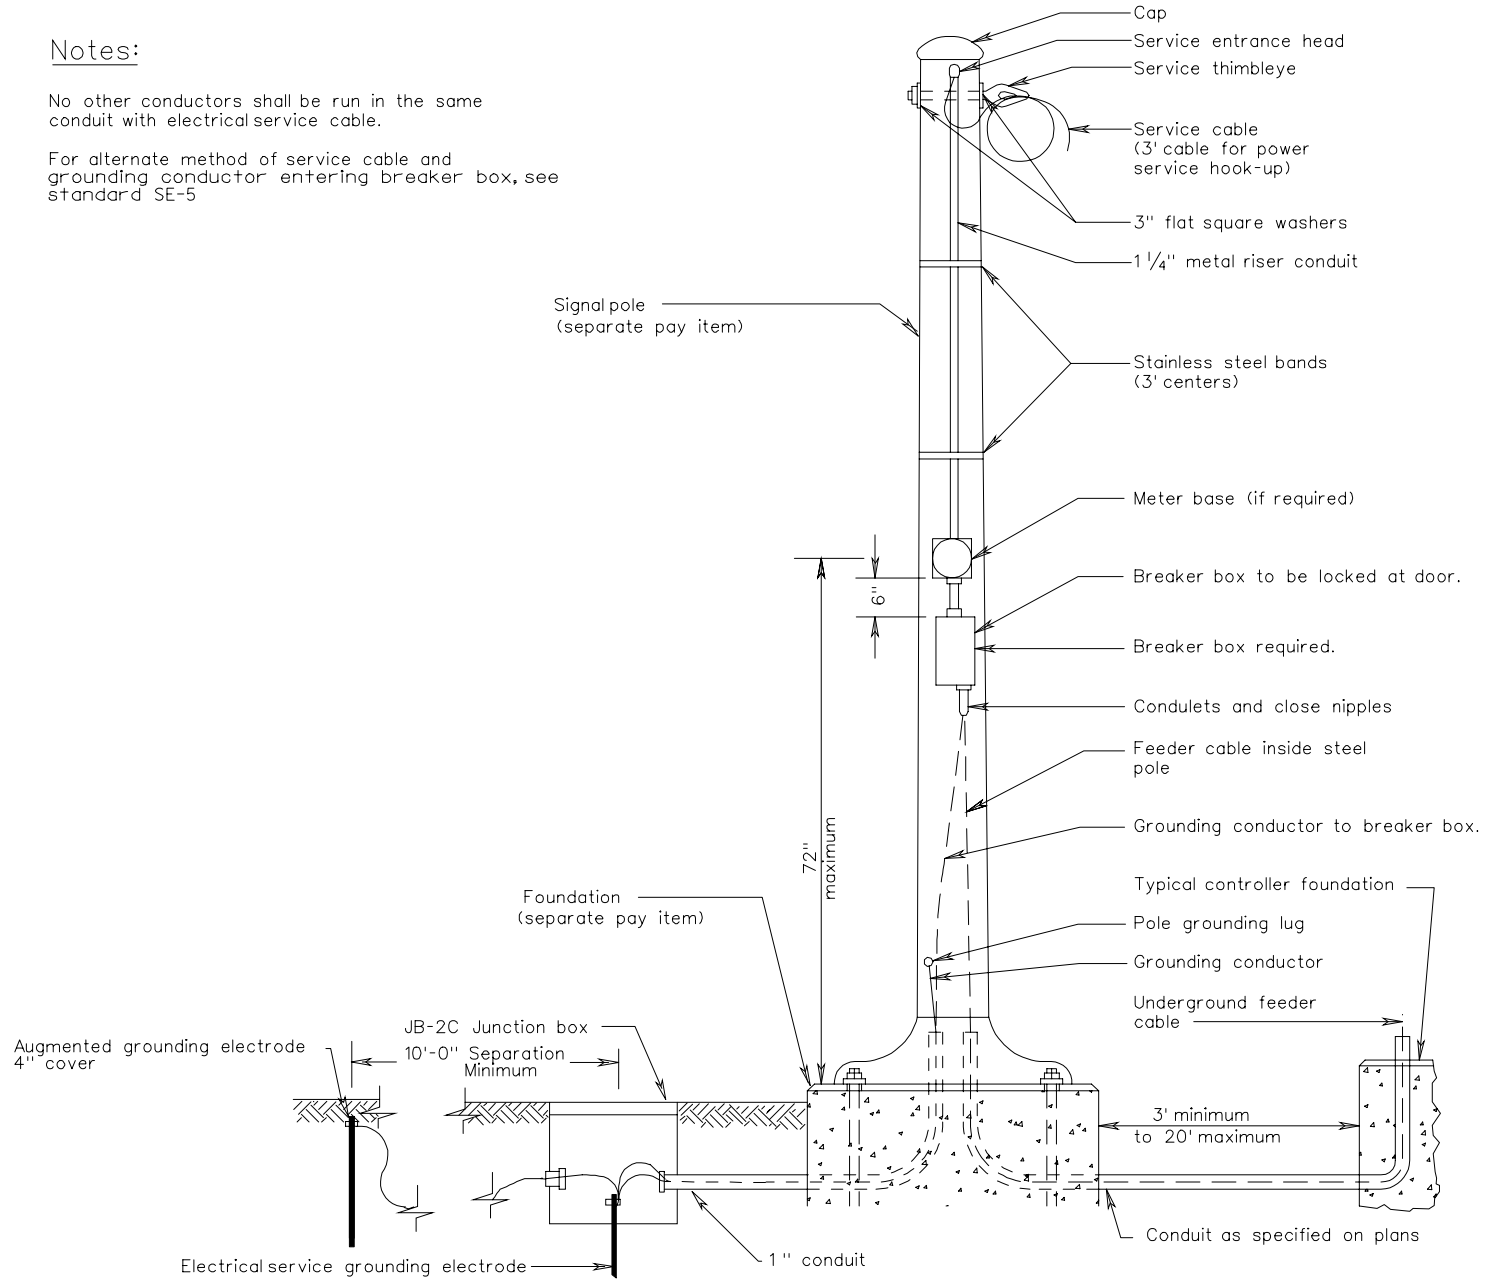

TYPE A

ELECTRICAL SERVICE DETAILS
 SIGNAL INSTALLATION
 VIRGINIA DEPARTMENT OF TRANSPORTATION