
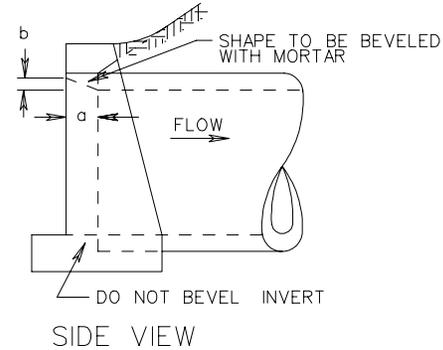
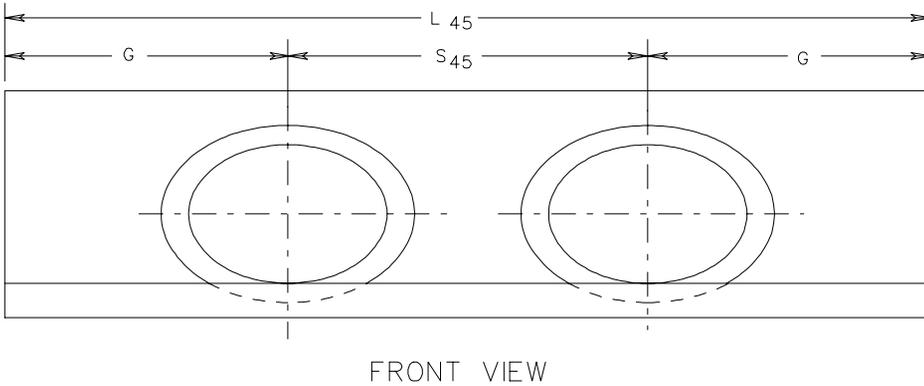


NOTES:

1. QUANTITIES GIVEN ARE FOR ONE ENDWALL. PLEASE REFER TO STANDARD EW-1, SHEET 101.01 FOR ALL DIMENSIONS NOT GIVEN IN TABLES.
2. FOR DETAILS OF BEVEL SEE STANDARD EW-2, 2A, SHEET 101.03.
3. THIS ITEM MAY BE PRECAST OR CAST IN PLACE.
4. ON SHALLOW FILLS, WHERE ENDWALLS ARE 1' OR LESS BELOW SHOULDER LINE, THE TOP OF THE ENDWALL SHALL BE CONSTRUCTED PARALLEL TO THE GRADE OF ROAD.
5. ALL CAST IN PLACE CONCRETE TO BE CLASS A3. FOR PRECAST SEE SHEET 101.16.
6. IN NO CASE SHALL TOP OF ENDWALL PROJECT ABOVE FILL SLOPE, DITCH SLOPE, OR SHOULDER.
7. THIS STANDARD TO BE USED WITH SKEW ANGLES FROM 37° 30' TO 45°.
8. HEADWALL TO BE BEVELED IN ALL AREAS EXCEPT WHERE A CONFLICT WITH INVERT AND WINGWALLS OCCUR.
9. BEVEL EDGE IS REQUIRED ON THE HEADWALL AT THE INLET END OF THE CULVERT (WHERE THE FLOW ENTERS THE CULVERT). HEADWALL AT THE OUTLET END OF THE CULVERT MAY BE EITHER SQUARE EDGE OR BEVEL EDGE.
10. 3/4" CHAMFER MAY BE PROVIDED ON ALL EDGES AT MANUFACTURER'S OPTION.

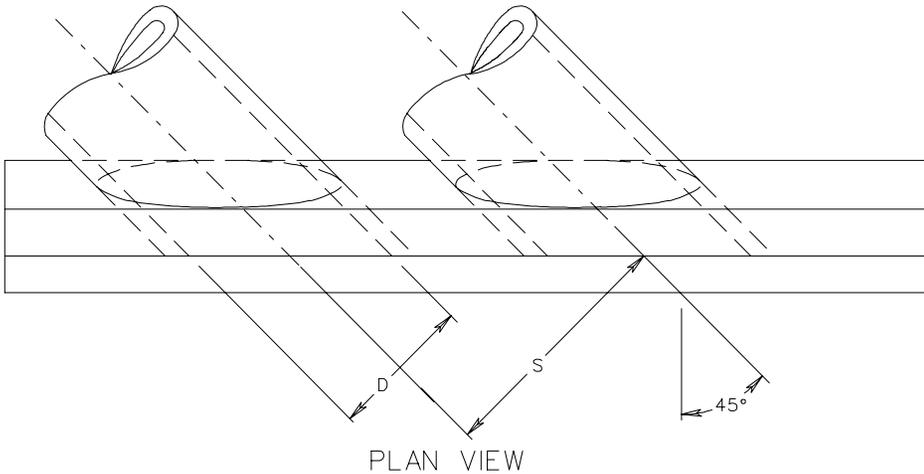

FOR CONCRETE PIPE								
D	G	S	S <sub>45</sub>	L <sub>45</sub>	CONCRETE IN ONE DOUBLE ENDWALL CUBIC YDS.	INCREASE FOR EACH ADDITIONAL PIPE CUBIC YDS.	a	b
12"	2'-0"	1'-10"	2'-7 <sup>7</sup> / <sub>8</sub> "	6'-7 <sup>7</sup> / <sub>8</sub> "	0.350	0.125	0'-1 <sup>1</sup> / <sub>4</sub> "	0'-1"
15"	2'-6"	2'-3"	3'-2 <sup>1</sup> / <sub>8</sub> "	8'-2 <sup>1</sup> / <sub>8</sub> "	0.714	0.235	0'-1 <sup>3</sup> / <sub>4</sub> "	0'-1 <sup>1</sup> / <sub>4</sub> "
18"	3'-0"	2'-8"	3'-9 <sup>1</sup> / <sub>4</sub> "	9'-9 <sup>1</sup> / <sub>4</sub> "	0.995	0.346	0'-2"	0'-1 <sup>1</sup> / <sub>2</sub> "
21" OR 24"	4'-0"	3'-6"	4'-11 <sup>3</sup> / <sub>8</sub> "	12'-11 <sup>3</sup> / <sub>8</sub> "	1.846	0.626	0'-2 <sup>1</sup> / <sub>2</sub> "	0'-2"
27" OR 30"	5'-0"	4'-4"	6'-1 <sup>1</sup> / <sub>2</sub> "	16'-1 <sup>1</sup> / <sub>2</sub> "	2.834	0.937	0'-3 <sup>1</sup> / <sub>4</sub> "	0'-2 <sup>1</sup> / <sub>2</sub> "
33" OR 36"	6'-0"	5'-2"	7'-3 <sup>5</sup> / <sub>8</sub> "	19'-3 <sup>5</sup> / <sub>8</sub> "	3.966	1.281	0'-3 <sup>3</sup> / <sub>4</sub> "	0'-3"

FOR CORRUGATED METAL PIPE								
D	G	S	S <sub>45</sub>	L <sub>45</sub>	CONCRETE IN ONE DOUBLE ENDWALL CUBIC YDS.	INCREASE FOR EACH ADDITIONAL PIPE CUBIC YDS.	a	b
12"	2'-0"	1'-7"	2'-2 <sup>7</sup> / <sub>8</sub> "	6'-2 <sup>7</sup> / <sub>8</sub> "	0.369	0.122	0'-1 <sup>1</sup> / <sub>4</sub> "	0'-1"
15"	2'-6"	1'-11 <sup>1</sup> / <sub>2</sub> "	2'-9 <sup>1</sup> / <sub>4</sub> "	7'-9 <sup>1</sup> / <sub>4</sub> "	0.746	0.246	0'-1 <sup>3</sup> / <sub>4</sub> "	0'-1 <sup>1</sup> / <sub>4</sub> "
18"	3'-0"	2'-4"	3'-3 <sup>5</sup> / <sub>8</sub> "	9'-3 <sup>5</sup> / <sub>8</sub> "	1.047	0.340	0'-2"	0'-1 <sup>1</sup> / <sub>2</sub> "
24"	4'-0"	3'-1"	4'-4 <sup>3</sup> / <sub>8</sub> "	12'-4 <sup>3</sup> / <sub>8</sub> "	1.956	0.625	0'-2 <sup>1</sup> / <sub>2</sub> "	0'-2"
27" OR 30"	5'-0"	3'-10"	5'-5"	15'-5"	3.030	0.948	0'-3 <sup>1</sup> / <sub>4</sub> "	0'-2 <sup>1</sup> / <sub>2</sub> "
36"	6'-0"	4'-7"	6'-5 <sup>3</sup> / <sub>4</sub> "	18'-5 <sup>3</sup> / <sub>4</sub> "	4.280	1.316	0'-3 <sup>3</sup> / <sub>4</sub> "	0'-3"

STANDARD ENDWALLS FOR MULTIPLE PIPE CULVERTS  
12"-36" PIPE-45° SKEW

SPECIFICATION REFERENCE

105  
302