




HALF PLAN

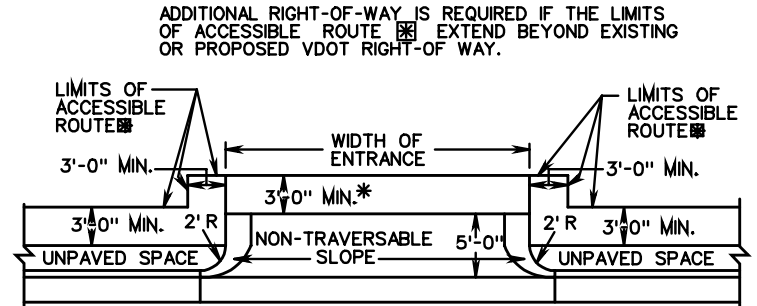

ACCESSIBLE ROUTE DETAIL




SECTION F-F

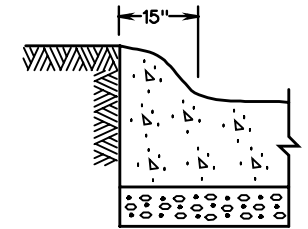


SECTION D-D

ACCESSIBLE ROUTE PROVIDE A CONTINUOUS UNOBSTRUCTED, STABLE, FIRM AND SLIP RESISTANT PATH CONNECTING ALL ACCESSIBLE ELEMENTS OF A FACILITY THAT CAN BE APPROACHED, ENTERED AND USED BY PEDESTRIANS.

* IF ACCESSIBLE ROUTES ARE BEING PROVIDED, A MINIMUM 3' TRAVERSABLE WIDTH IS REQUIRED WITH A MAX. 2% CROSS SLOPE.

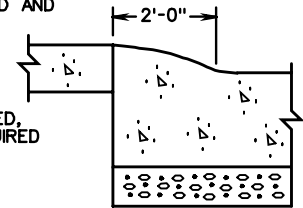

SECTION E-E

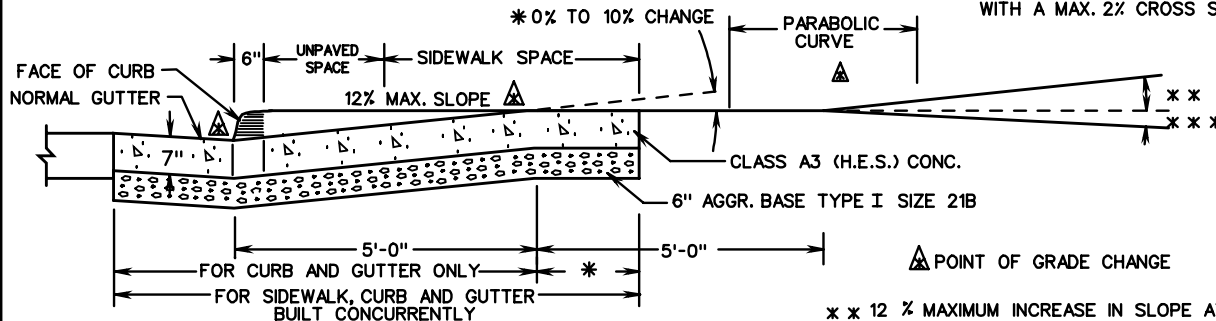

SECTION C-C

WHEN USED IN CONJUNCTION WITH STANDARD CG-3 OR CG-7, THE CURB FACE ON THIS STANDARD IS TO BE ADJUSTED TO MATCH THE MOUNTABLE CURB CONFIGURATION.

* * 12 % MAXIMUM INCREASE IN SLOPE AT MINIMUM 10' INTERVALS
 * * * 3 % MAXIMUM DECREASE IN SLOPE FOR FIRST 10' INTERVAL AND
 8 % MAXIMUM DECREASE FOR SUCCEEDING MINIMUM 10' INTERVALS

SPECIFICATION REFERENCE
502

STANDARD ENTRANCE GUTTER FOR USE WITH UNPAVED SPACE BETWEEN CURB & SIDEWALK

VIRGINIA DEPARTMENT OF TRANSPORTATION