


ALTERNATE METHOD OF SERVICE CABLE AND GROUNDING CONDUCTOR ENTERING BREAKER BOX

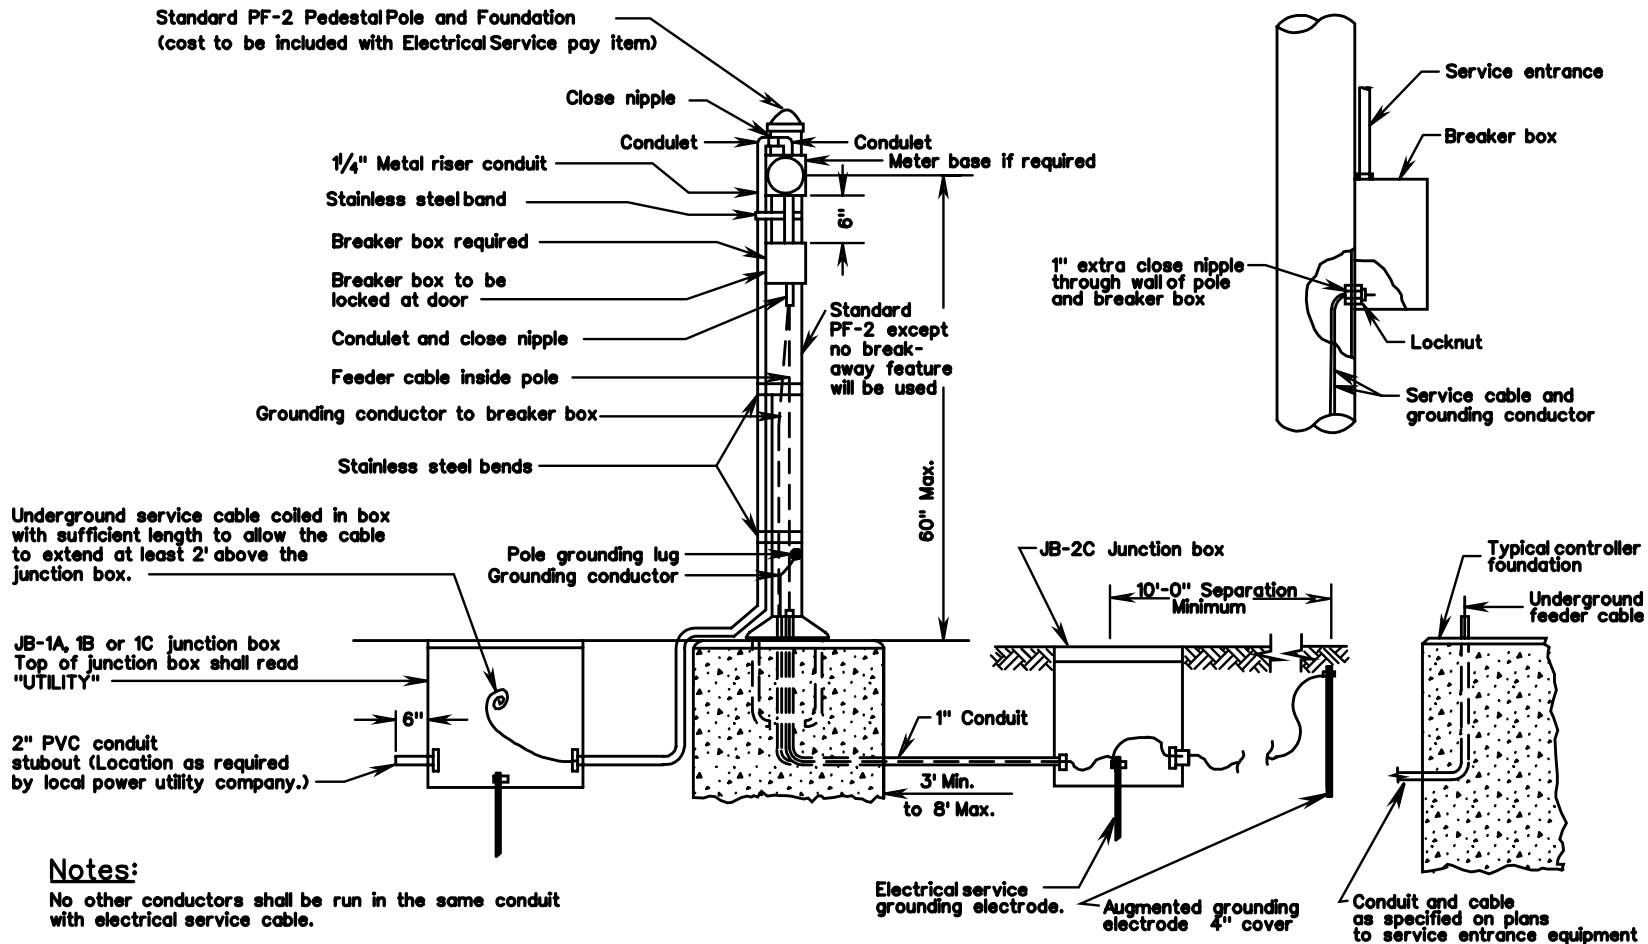

Notes:

No other conductors shall be run in the same conduit with electrical service cable.

Local power utility company will install service power utility cable from their power source to the junction box and make required splices to the service cable coiled in the junction box.

PEDESTAL POLE WITH GROUND MOUNTED CABINET

ELECTRICAL SERVICE DETAILS SIGNAL INSTALLATION

VIRGINIA DEPARTMENT OF TRANSPORTATION