



LP-1

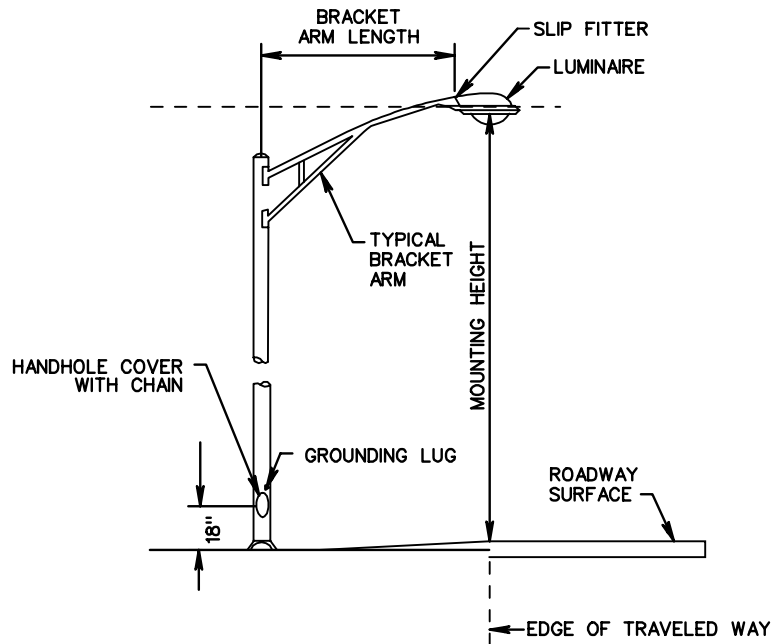

LP-2

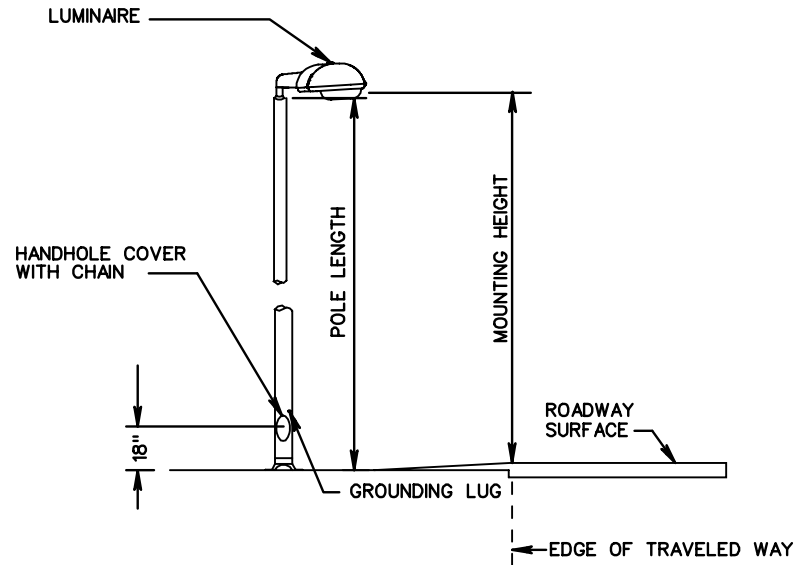

POLE LENGTH (FEET)	BOLT CIRCLE DIAMETER	ANCHOR BOLT DIAMETER
A (5-17)	12"	1"
B (18-22)	12"	1"
C (23-27)	12"	1"
D (28-32)	12"	1"
E (33-37)	15"	1"
F (38-42)	15"	1"
G (43-47)	15"	1"
H (48-52)	16"	1"
I (53-57)	16"	1 1/4"
J (58-62)	16"	1 1/4"

NOTES:

THE MOUNTING HEIGHT SHOWN ON THE PLANS SHALL BE ADHERED TO WITHIN A TOLERANCE OF 12" AND IN NO CASE LESS THAN THE MOUNTING HEIGHT SHOWN.

GROUNDING ELECTRODE SHALL BE COVERED 4-18" FROM FINISHED GRADE.

REFER TO STANDARD MP-2 FOR GROUNDING LUG DETAIL.

NOTES:

GROUNDING ELECTRODE SHALL BE COVERED 4-18" FROM FINISHED GRADE.

REFER TO STANDARD MP-2 FOR GROUNDING LUG DETAIL.



ROAD AND BRIDGE STANDARDS

SHEET 1 OF 1

REVISION DATE

1311.10

LIGHTING POLE  
INSTALLATION DETAILS

VIRGINIA DEPARTMENT OF TRANSPORTATION

SPECIFICATION  
REFERENCE

700