


PLAN NO.	REVISED BY	DATE
NOTE BOOK NO.	NO.	
PROJECT NO.		


DATE PLOTTED: 11/11/06

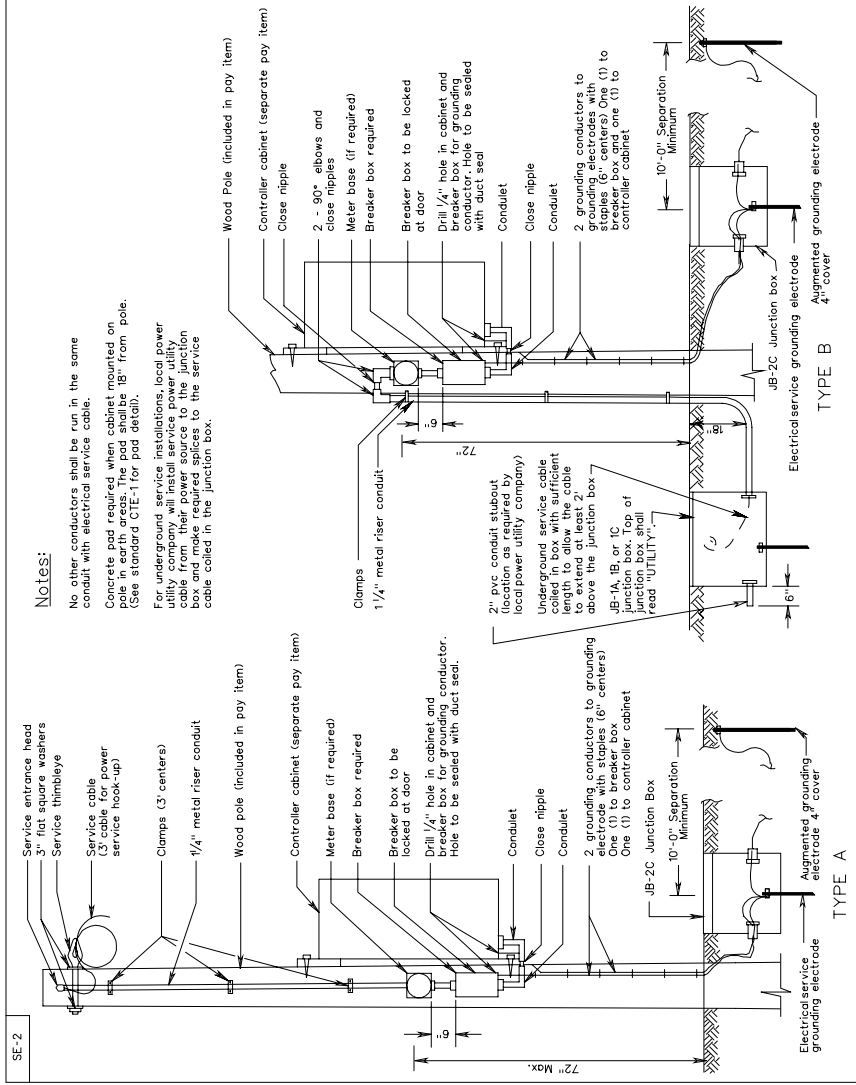

ELECTRICAL SERVICE DETAILS
SIGNAL INSTALLATION

REV. 2/06
1301.132

VIRGINIA DEPARTMENT OF TRANSPORTATION

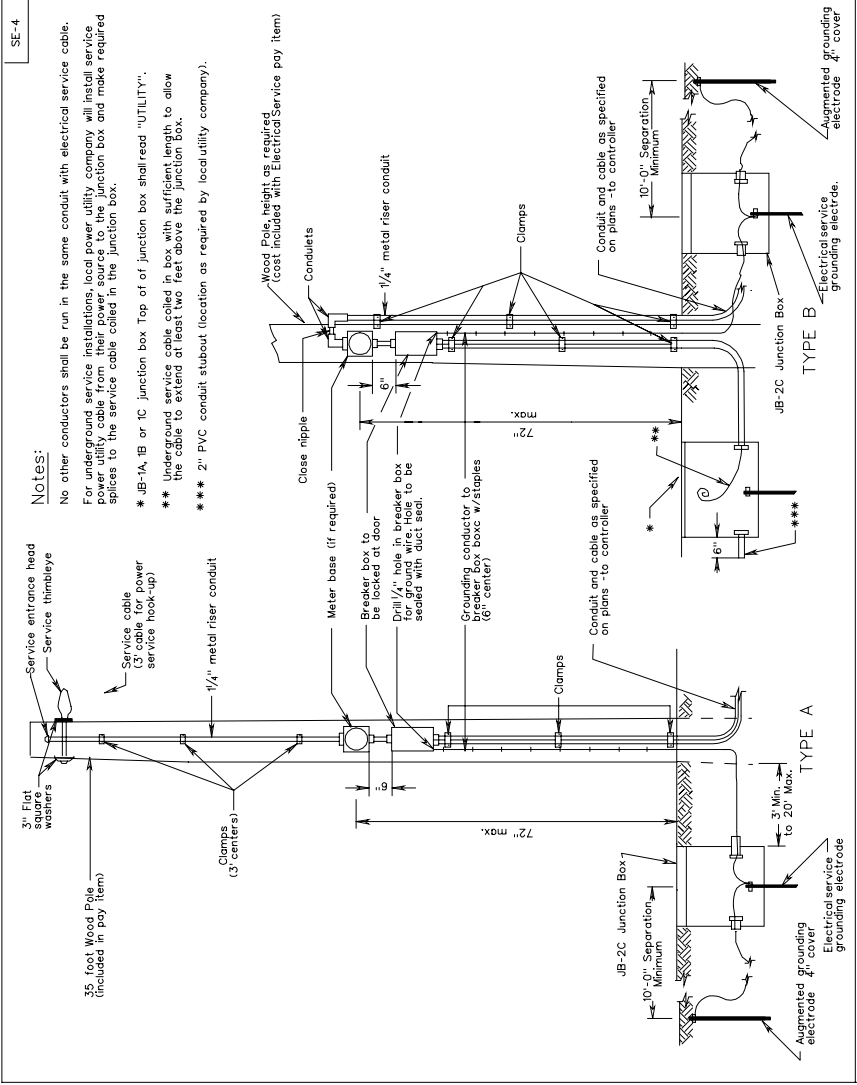

SE-4

NOTES:

- No other conductors shall be run in the same conduit with electrical service cable.
- For underground service installations, local power utility company will install service power utility cable from their power source to the junction box and make required splices to the service cable coiled in the junction box.
- * JB-1A, 1B or 1C Junction box Top of junction box shall read "UTILITY".
- ** Under-ground service cable coiled in box with sufficient length to allow the cable to extend at least two feet above the junction box.
- *** 2" PVC conduit stubout (location as required by local utility company).

NEW 2/06
SPECIAL DESIGN SECTION
DRAWING NO. A - 173

DESIGN FEATURES RELATING TO CONSTRUCTION OR TO REGULATION AND CONTROL OF TRAFFIC MAY BE SUBJECT TO CHANGE AS DEEMED NECESSARY BY THE DEPARTMENT

REVISED	FHWA REGION	STATE	FEDERAL AID PROJECT	ROUTE	STATE PROJECT	SHEET NO.
	3	VA.				

ELECTRICAL SERVICE DETAILS
SIGNAL INSTALLATION

REV. 2/06
1301.135

VIRGINIA DEPARTMENT OF TRANSPORTATION