

SURVEYED BY \_\_\_\_\_  
 SUPERVISED BY \_\_\_\_\_  
 DESIGNED BY \_\_\_\_\_


DESIGN FEATURES RELATING TO CONSTRUCTION  
 OR TO REGULATION AND CONTROL OF TRAFFIC  
 MAY BE SUBJECT TO CHANGE AS DEEMED  
 NECESSARY BY THE DEPARTMENT

| REVISED | STATE | FEDERAL AID | ROUTE | STATE   | SHEET NO. |
|---------|-------|-------------|-------|---------|-----------|
|         |       | PROJECT     |       | PROJECT |           |
|         |       |             |       |         |           |

Appendix IIA-14

Section II - Signing

SIGN LIGHTING / ELECTRICAL SERVICE

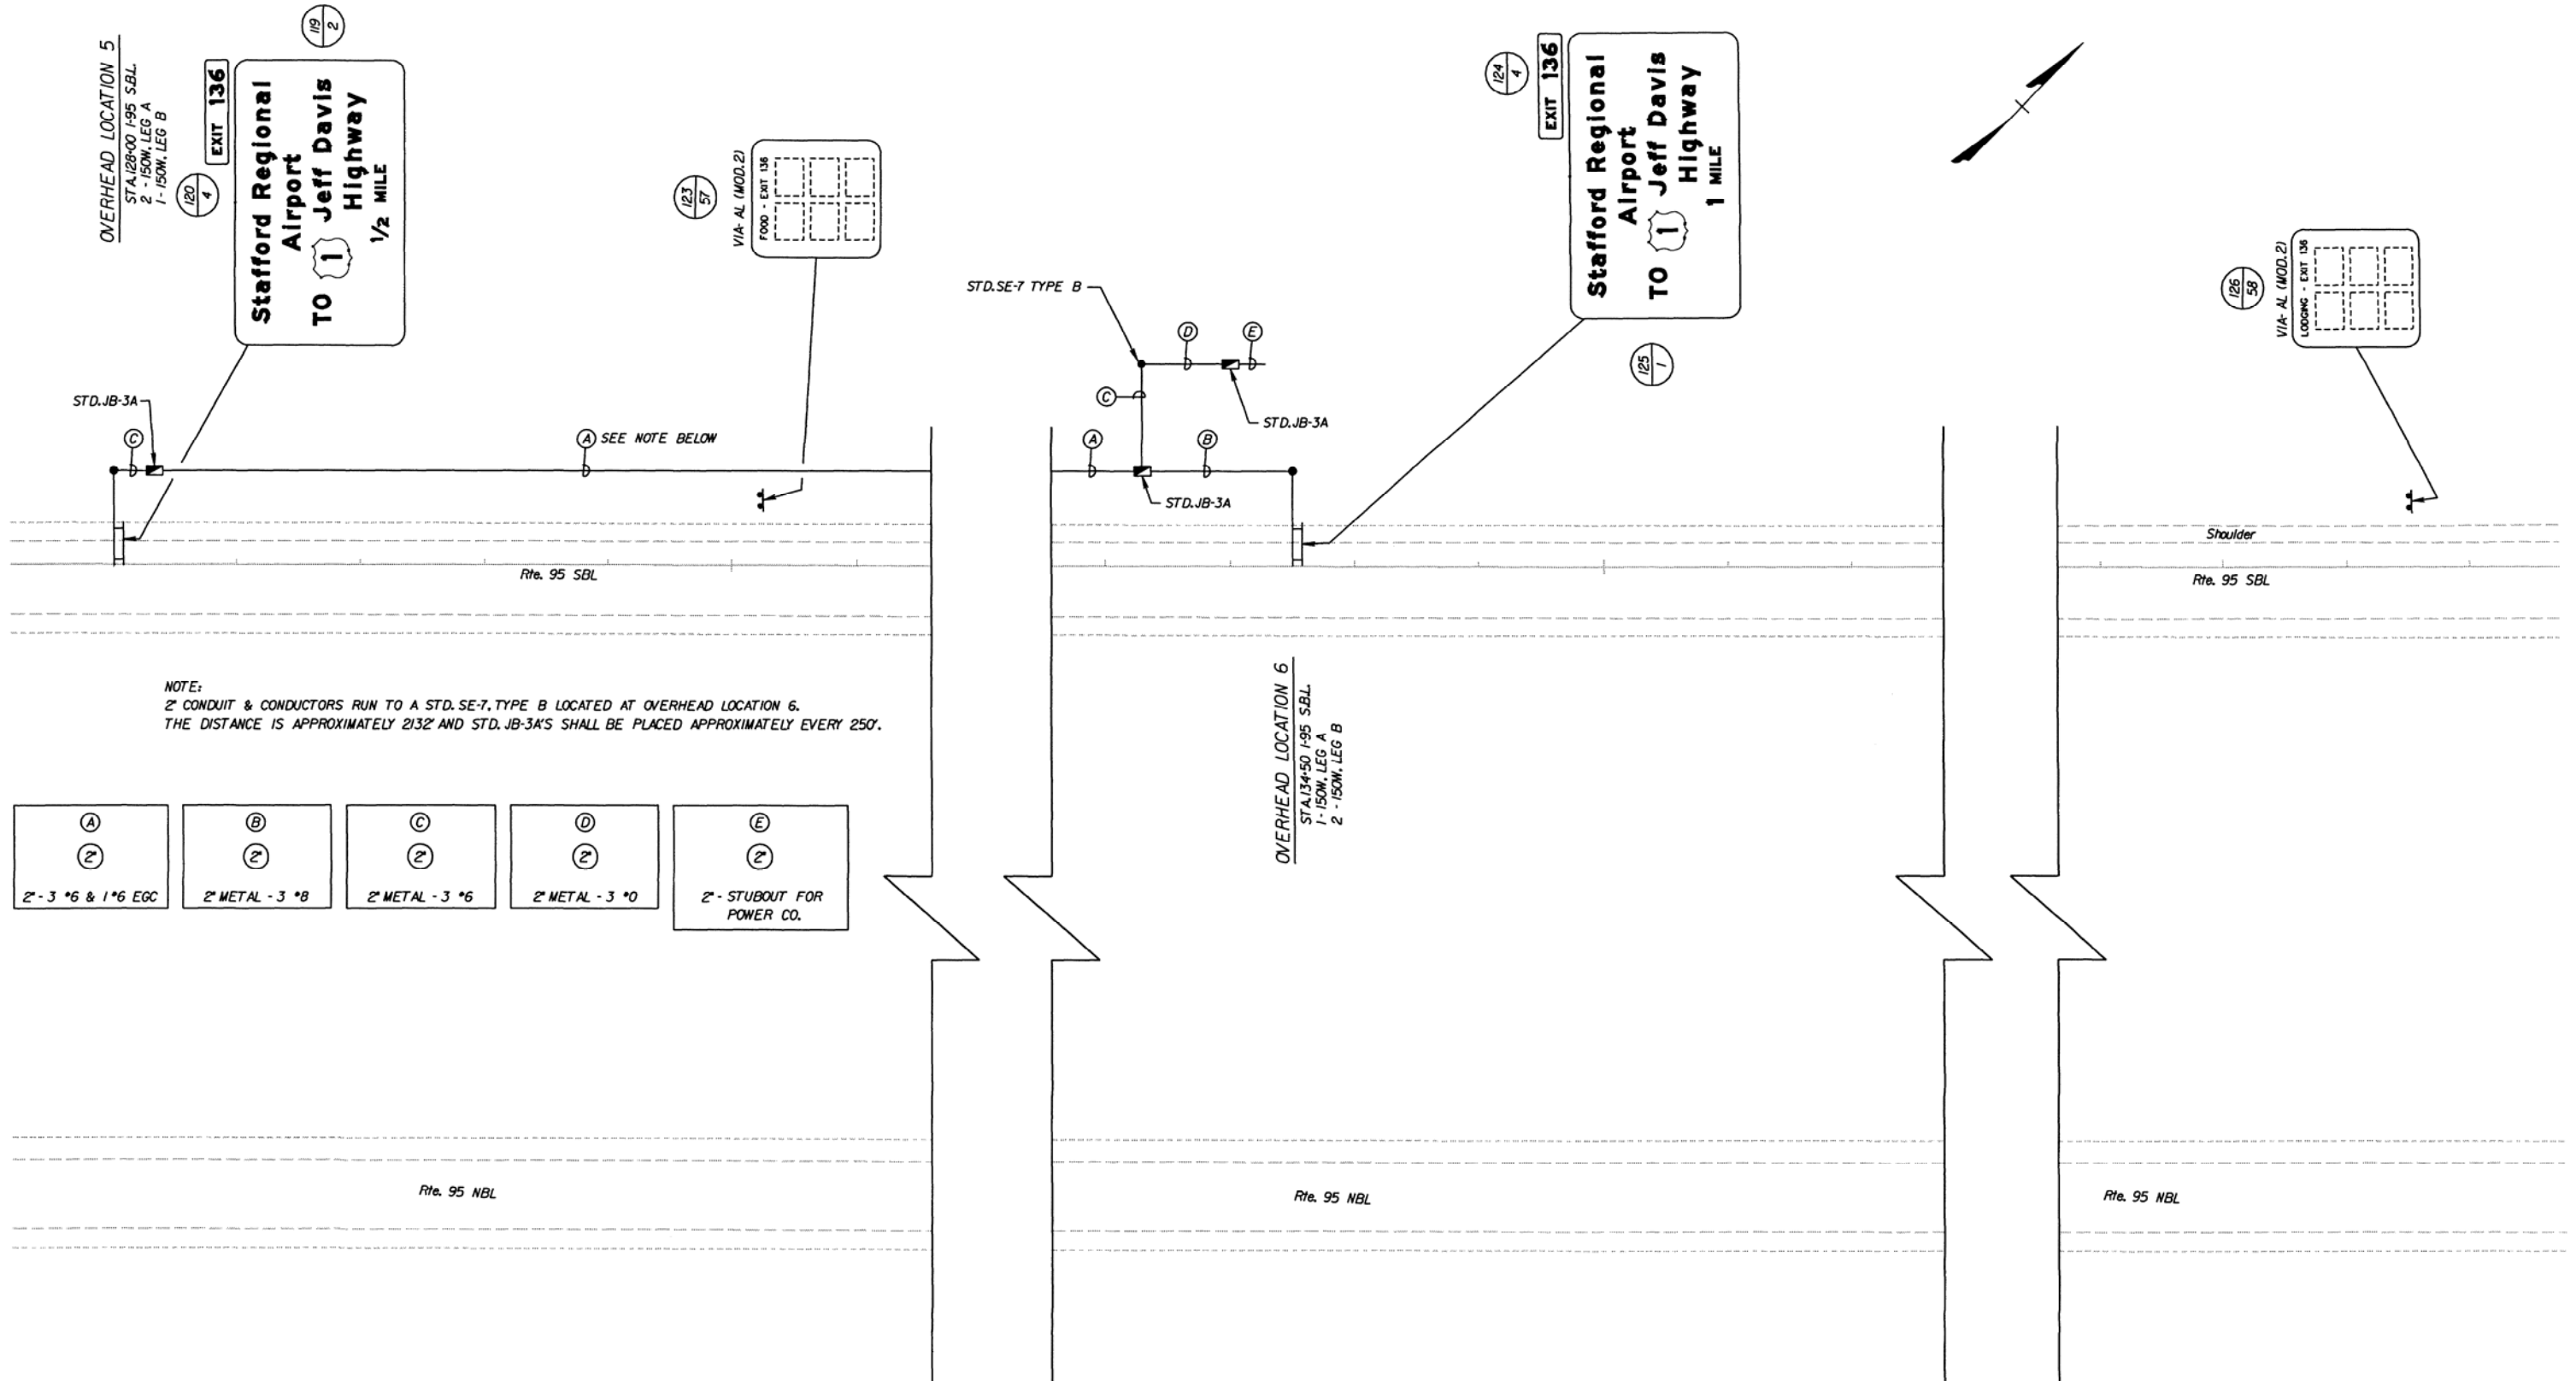

NOTE:  
 2" CONDUIT & CONDUCTORS RUN TO A STD.SE-7, TYPE B LOCATED AT OVERHEAD LOCATION 6.  
 THE DISTANCE IS APPROXIMATELY 2132' AND STD.JB-3A'S SHALL BE PLACED APPROXIMATELY EVERY 250'.

|                      |                 |                 |                 |                            |
|----------------------|-----------------|-----------------|-----------------|----------------------------|
| A<br>2"              | B<br>2"         | C<br>2"         | D<br>2"         | E<br>2"                    |
| 2'-3" *6 & 1" *6 EGC | 2" METAL - 3 *8 | 2" METAL - 3 *6 | 2" METAL - 3 *0 | 2" - STUBOUT FOR POWER CO. |

ROADWAY SIGNING  
 PLAN

| PLAN NO. | PROJECT | FILE NO. | SHEET NO. |
|----------|---------|----------|-----------|
|          |         |          |           |