


**Notes:**

No other conductors shall be run in the same conduit with electrical service cable.

For alternate method of service cable and grounding conductor entering breaker box, see standard SE-5

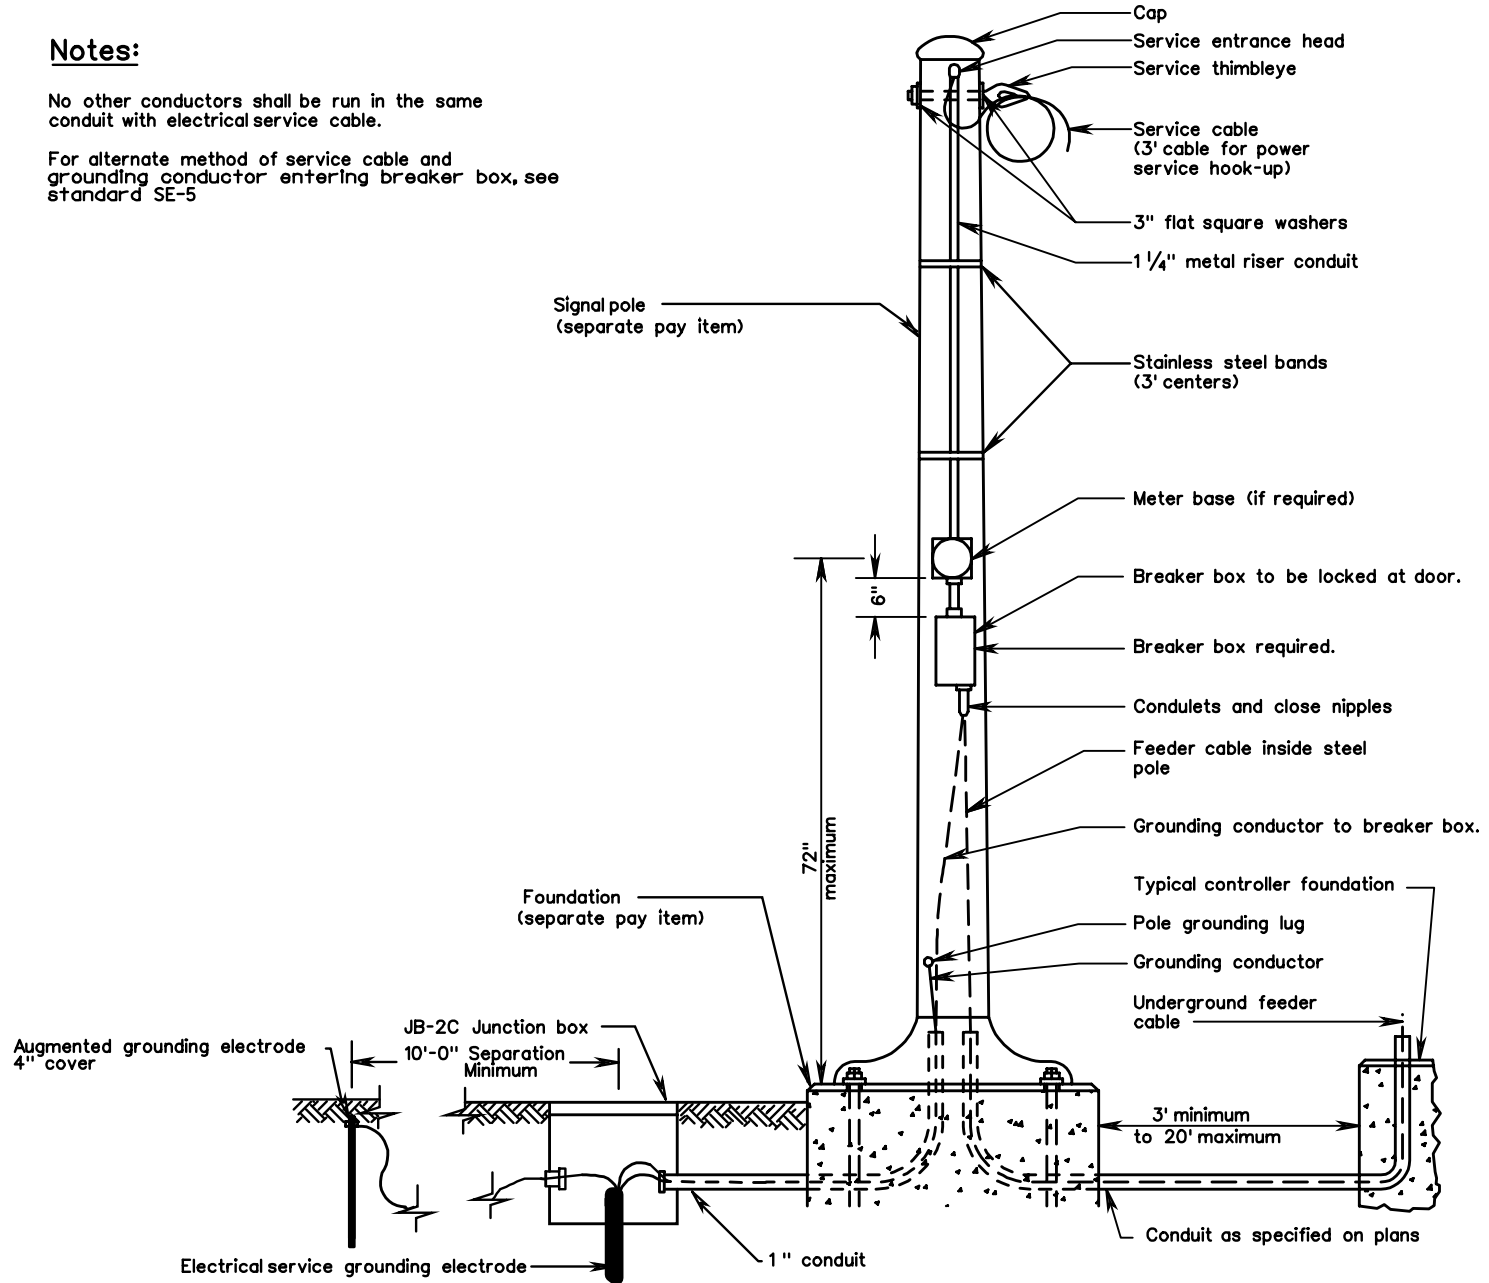

TYPE A

**ELECTRICAL SERVICE DETAILS  
SIGNAL INSTALLATION**  
VIRGINIA DEPARTMENT OF TRANSPORTATION