


* WATER STOPS TO BE ELASTOMERIC OR OTHER APPROVED MATERIAL DIMENSIONS SHOWN ARE ABSOLUTE MINIMUM.

EXPANSION JOINTS AT INTERVALS NOT EXCEEDING 90'.

HEIGHT OF WALL "H" IN FEET	THICKNESS AT TOP "A" IN FEET	THICKNESS AT BASE B=.6H	COMPRESSION AT TOE LBS. PER SQ. FT.	AREA OF SECTION SQ. FT.
3	1'-0''	1'-95/8''	856	4.83
4	1'-0"	2'-4¾"	1141	7.43
5	1'-0"	3'-0"	1427	10.63
6	1'-0''	3'-71/4"	1712	14.43
7	1'-0"	4'-23/8''	1997	18.83
8	1'-0''	4'-95%''	2283	23.83
9	1'-0"	5'-4¾''	2568	29.43
10	1'-0''	6'-0"	2853	35.63
11	1'-1 1/4 "	6'-71/4"	3139	42.98
12	1'-2 3/8 "	7'-23/8"	3424	51.03
13	1'-3 5/8 "	7'-95%''	3709	59.78
14	1'-4 3/4 "	8'-4¾''	3995	69.23
15	1'-6"	9'-0"	4280	79.38

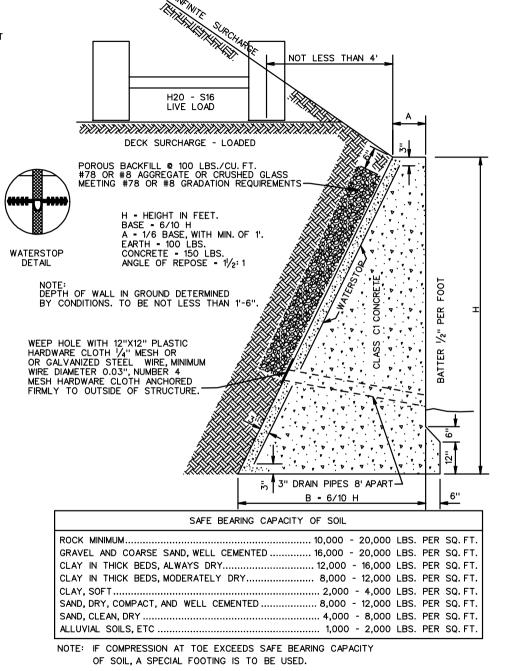

CONCRETE GRAVITY RETAINING WALLS INFINITE SURCHARGE AND DECK SURCHARGE - LOADED

VIRGINIA DEPARTMENT OF TRANSPORTATION

SPECIFICATION REFERENCE

506

REV 8/07 401.02